


GENERAL NOTES


1. UTILITY SERVICE DROP IS PROPOSED ONLY. A UTILITY REPRESENTATIVE WILL NEED TO APPROVE LOCATION PER UTILITY APPLICATION REQUIREMENTS. CONTRACTOR IS RESPONSIBLE FOR SUBMITTING REQUIRED SERVICE APPLICATION.
2. IF POLE SIGN REQUIRED IS REQUIRED, VERIFY LOCATION AND ROUTE 2#10,#10GND,3/4"C FROM CIRCUIT A-5.

KEYED NOTES - ELECTRICAL

1. 2#10,#10GND,3/4"C. CONTROL THROUGH TIME SWITCH LOCATED IN ELECTRICAL ROOM. SEE KEYED NOTE 6E2.0.
2. PROPOSED ROUTING OF 3/4" CONDUITS WITH PULL STRING FOR TELEPHONE, DATA, AND CABLE; TO BUILDING ELECTRICAL ROOM. COORDINATE WITH TELEPHONE COMPANY.
3. POLE MOUNTED TRANSFORMER(S) BY UTILITY. HIGH VOLTAGE TO 120V/208V, 3PHASE, 4 WIRE.
4. LOCATION OF MAIN ELECTRICAL SERVICE ENTRY. SEE SHEET E3.0.
5. LOCATION OF BUILDING ELECTRICAL PANELS. SEE SHEET E3.0.
6. LOCATION OF MAIN TELEPHONE PATCH PANEL. SEE SHEET E3.0.
7. NEW UTILITY POLE IF REQUIRED. COORDINATE WITH CITY OF BOERNE PUBLIC WORKS FOR ELECTRICAL SERVICE DROP.
8. UTILITY UNDERGROUND SERVICE TO BUILDING. SEE RISER DIAGRAM ON SHEET E0.1.
9. RELOCATE EXISTING LIGHT POLE AND CIRCUITING TO LOCATION INDICATED.
10. EXISTING LIGHT POLE TO REMAIN.

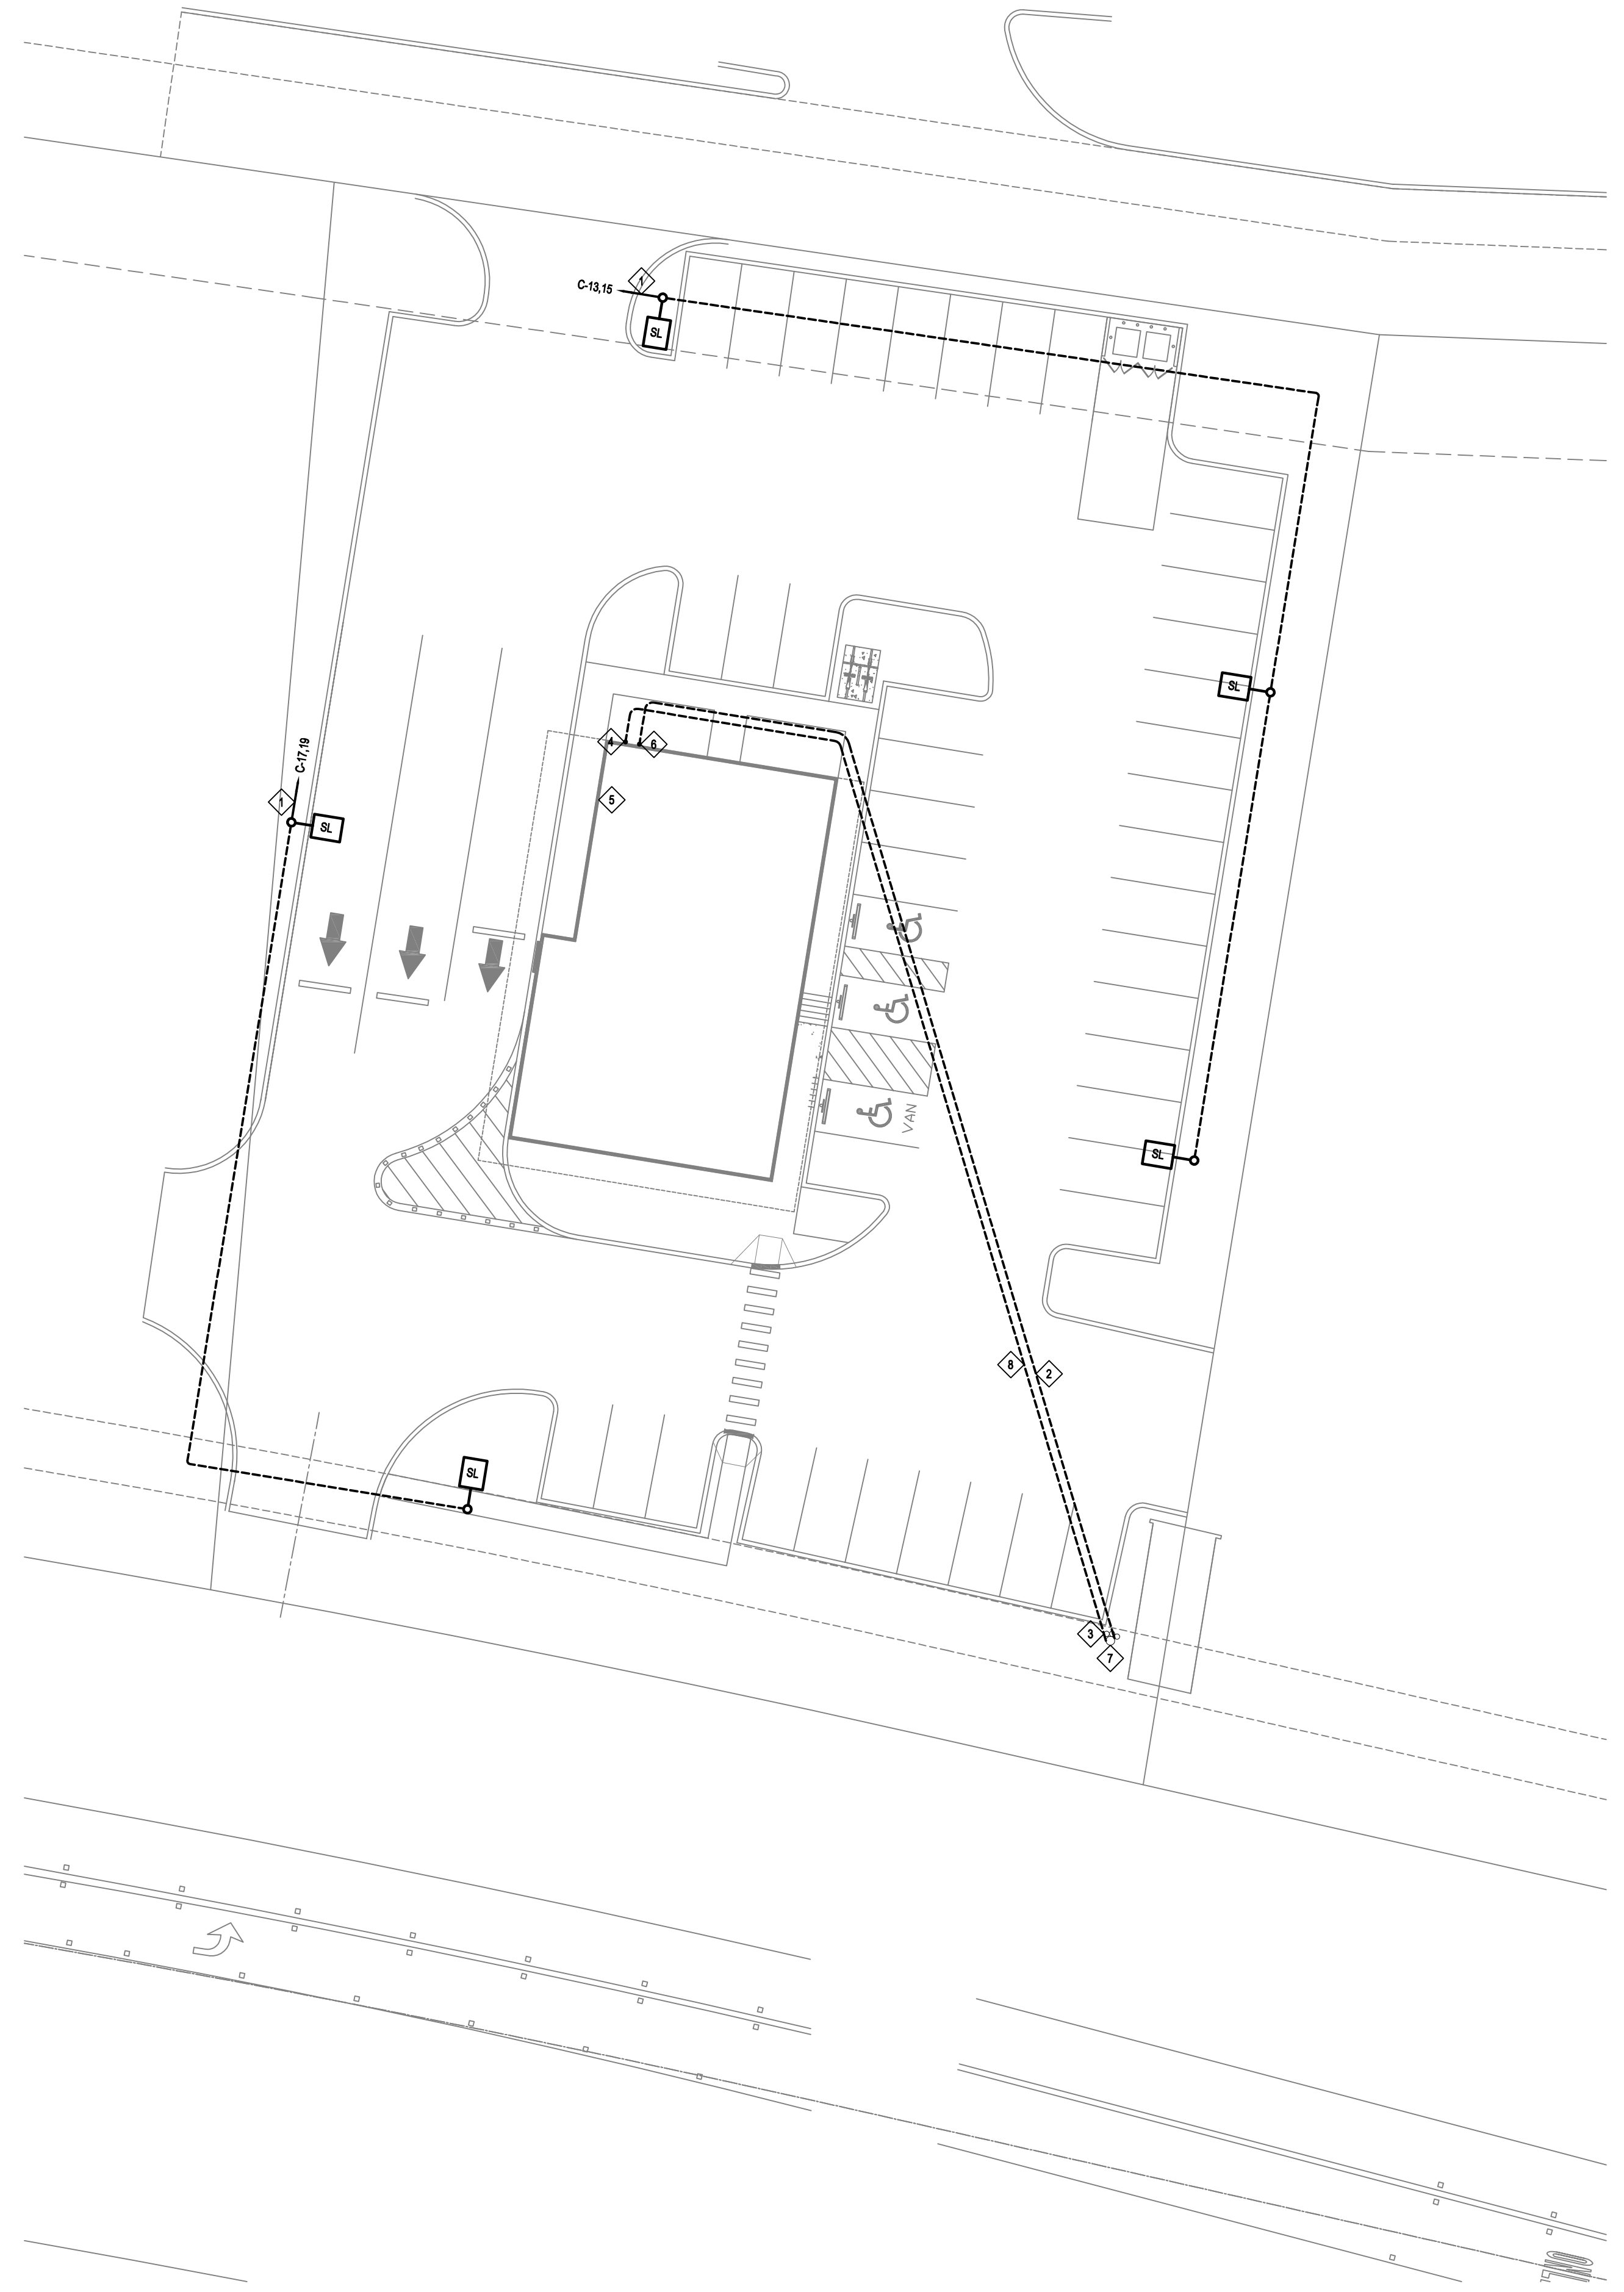

1 ELECTRICAL SITE PLAN
 SCALE: 1" = 20'-0"

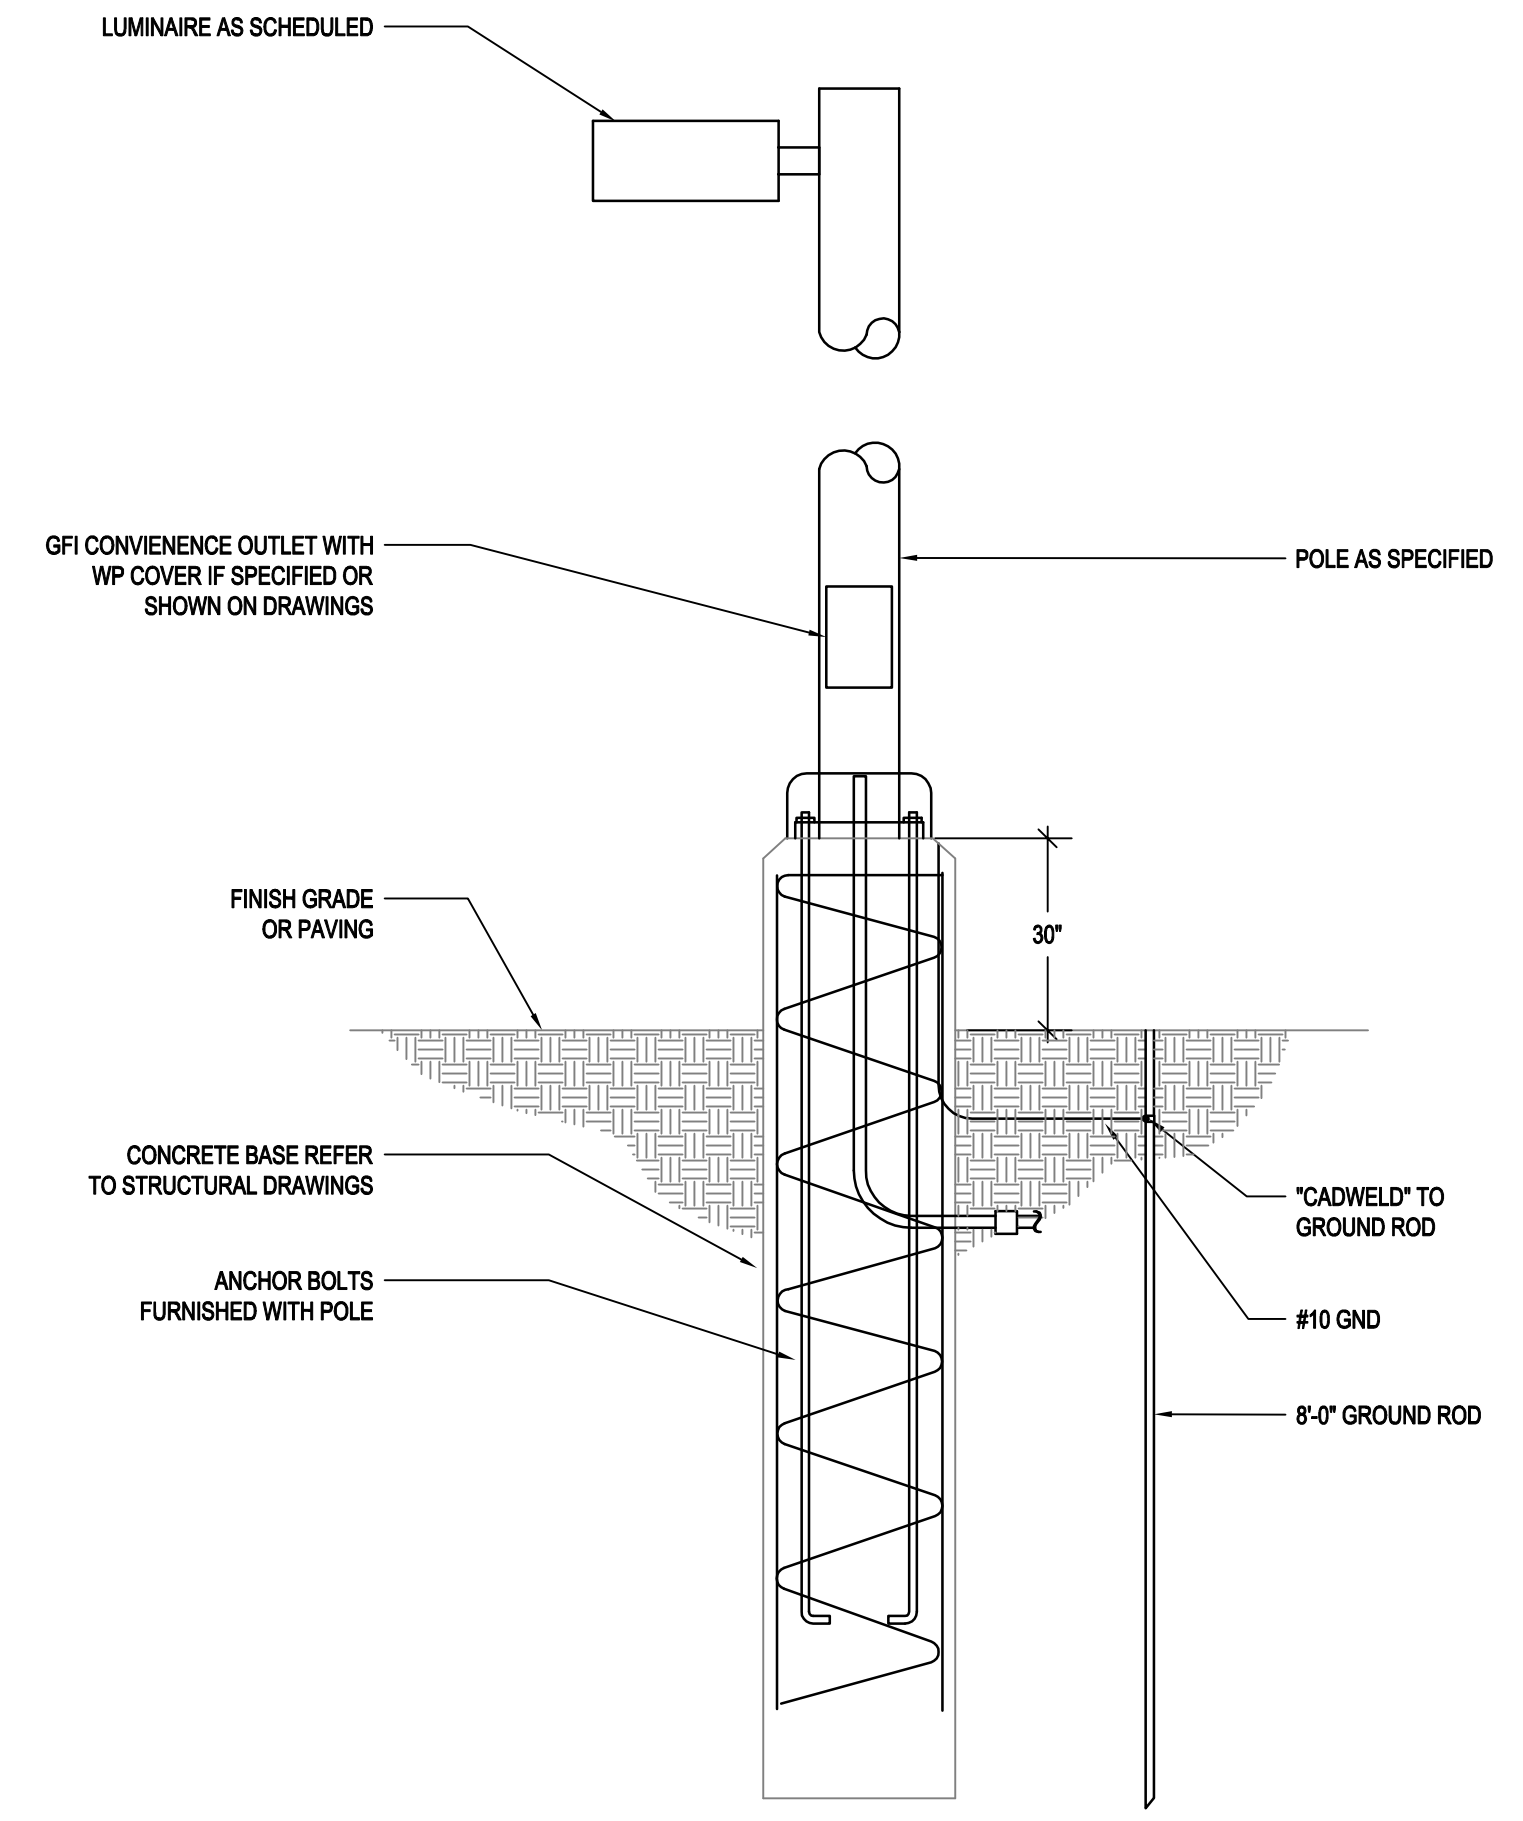

2 POLE BASE DETAIL
 SCALE: NONE

Plot Time: Monday, January 11, 2016 2:42:37 PM - Plotted By: PATRICK HOWARD
 This file block has been modified to plot correctly using an MEP plot configuration.