UPDATED 06/29/16

FIELD VERIFICATION IS A TENANT RESPONSIBILITY BY TENANT AT TENANT EXPENSE.

SHOPCORE PROPERTIES
- ☐ APPROVED
- ☒ APPROVED AS NOTED
- ☐ REVISE AND RESUBMIT
- ☐ REJECTED

Shatha Odish
Tenant Project Manager

⑰ RESERVED

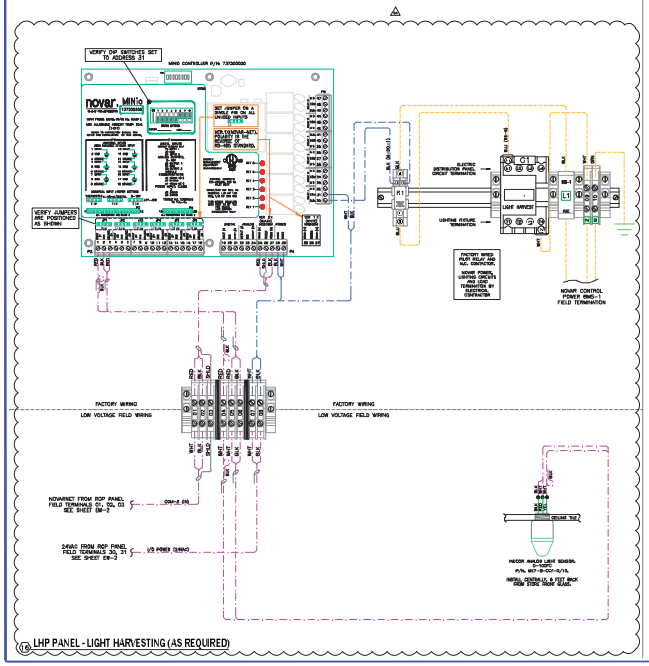

⑱ LHP PANEL - LIGHT HARVESTING (AS REQUIRED)

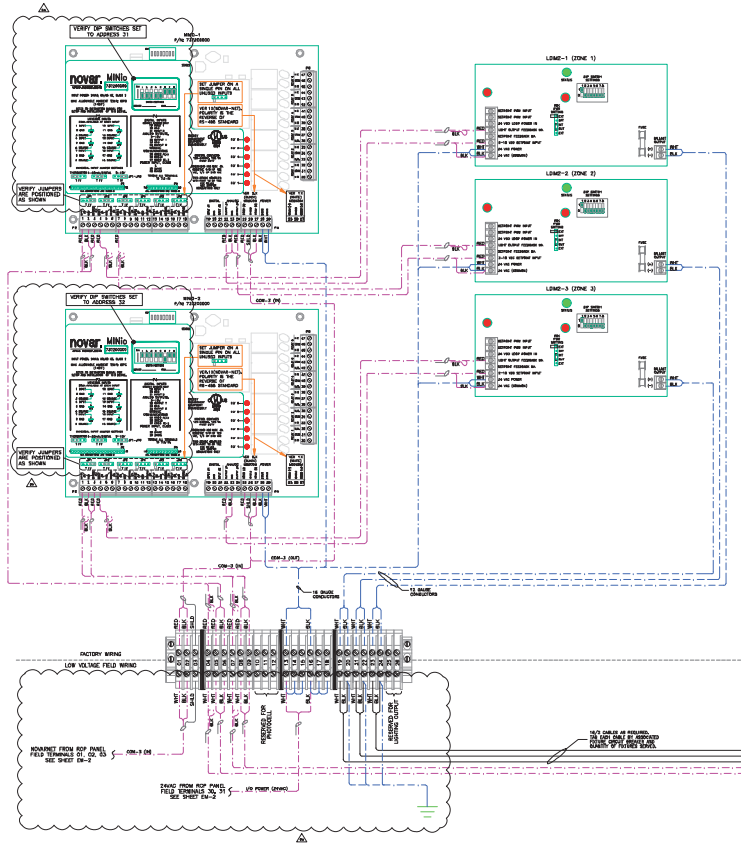

⑲ LDP PANEL - LIGHT DIMMING (AS REQUIRED)

⑯ RESERVED



⑭ ZONE 3 - DIMMABLE LIGHTING BALLAST DETAIL



⑬ ZONE 2 - DIMMABLE LIGHTING BALLAST DETAIL



⑫ ZONE 1 - DIMMABLE LIGHTING BALLAST DETAIL



⑩ ZONE 1 - INDOOR PHOTOCELL DETAIL



⑪ ZONE 2 - INDOOR PHOTOCELL DETAIL

REVISIONS	REV.	DESCRIPTION
Revision 01	RJJ	10/15/15	Added ROP, LDP revisions.
Revision 02	RJJ	01/25/16	Changed C4 contactor label to "Light Harvesting".
Revision 03	RJJ	05/06/16	Override Button 3 wiring change.
Revision 04	RJJ	06/29/16	Added Pre Sales Area changes, modified installation notes.

LEGEND
- (#) NOTE—THIS SHEET
- (1) DETAIL NUMBER
- DETAIL: DEVICE ID NUMBER OVER DEVICE CATEGORY NUMBER
- (#) WIRE ID
- • DESIGNATED WIRE SPLICE
- SECURED SPARE CONDUCTOR FOR FUTURE USE

WIRE/CABLE TYPES
ALL TYPES MAY NOT APPLY.
- (A) 22/2 AWG SHIELDED GROUND * BELDON 8761
- (B) 22/3 AWG SHIELDED GROUND * WINDY CITY 004330
- (C) 18/2 AWG SHIELDED GROUND * HONEYWELL 3320 10 01
- (D) 18/3 AWG STRANDED CABLE PLENUM RATED
- (E) LINE VOLTAGE WIRING IN CONDUIT
- (F) 20/2 AWG SHIELDED AND 18/2 AWG, * BELDEN 9155
- (G) 12 TO 18 AWG STRANDED WIRE * THHN.

* OR EQUIVALENT.

LOW VOLTAGE CABLING REQUIREMENTS:
1. WIRE SPLICES ARE UNACCEPTABLE.
2. THE COMMUNICATIONS BUSS WILL BE TERMINATED AT THE CONTROLLER.
3. INSTALLED NEATLY AND CONCEALED WITHIN THE BUILDING STRUCTURE.
4. SLEEVED IN CONDUIT UP TO CEILING OR BAR JOIST.

novar
6060 Rockside Woods Blvd.
Cleveland, OH 44131
216.682.1600
www.novar.com

DOLLAR TREE

Energy Management Plan

Application Engr	Project/Program Mgmt
R. James	CR / GN
Date	Use Nbr
11/13/2014	U-

Optional Daylight Harvesting Wiring Details

Scale	Dwg. Nbr
N.T.S.	EM-4