

LIGHTING NOTE:  
REG 2018 SECTION 70000 (9)


THE BRANCH CIRCUIT FEEDING THE UNIT EQUIPMENT SHALL BE THE SAME BRANCH CIRCUIT AS THAT SERVING THE NORMAL LIGHTING IN THE ROOM AND CONNECTED AHEAD OF ANY LOCAL SWITCHES. THE BRANCH CIRCUIT THAT FEEDS UNIT EQUIPMENT SHALL BE CLEARLY IDENTIFIED AT THE DISTRIBUTION PANEL. EXCEPTION:  
IN A SEPARATE AND UNOCCUPIED AREA SUPPLIED BY A TRUNK OF THREE NORMAL LIGHTING CIRCUITS, A SEPARATE BRANCH CIRCUIT FOR UNIT EQUIPMENT SHALL BE INSTALLED IF IT ORIGINATES FROM THE SAME PANELBOARD AS THAT OF THE NORMAL LIGHTING CIRCUITS AND IS PROVIDED WITH A LOCK-ON FEATURE.

NOTE:  
REFER TO ARCH ADD FOR DIMENSIONS OF LIGHTING

SCALE: 3/16" = 1'-0"

TYPE	SYMBOL	MANUFACTURER	DESCRIPTION	HOUSING	LAMP(S)	VOLTS	WATTS	REMARKS
A		TEXAS FLUORESCENTS C2000L20000	4' COMMERCIAL WIDE LINEAR LED STRIPLITE	SURFACE MOUNTED	2 LAMP LED	00071	36	PROVIDED + INSTALLED BY LL
AI		TEXAS FLUORESCENT/FIB SERIES (MODEL 33000L20000P)	8' HUBWAY LINEAR LED HUBWAY STRIP	CHAN HNG H2004 (2 PER LIGHT)	0 LAMP LED	00071	108	PROVIDED + INSTALLED BY LL A/NL 801- 866 ELEC PLANS FOR BRNG
AI1		TEXAS FLUORESCENT/FIB SERIES (MODEL 33000L20000P)	8' HUBWAY LINEAR LED HUBWAY STRIP	CHAN HNG H2004 (2 PER LIGHT)	0 LAMP LED	00071	34	PROVIDED + INSTALLED BY LL
AI2		TEXAS FLUORESCENT C2000L20000	4' COMMERCIAL WIDE FLUORESCENT TANDUM STRIPLITE	CHAN HNG H2004 (2 PER LIGHT)	4 LAMP LED	00071	17	PROVIDED + INSTALLED BY LL A/NL 801- 866 ELEC PLANS FOR BRNG
B			FALSE SECURITY CAMERA + SIGN AT 8'-0" x 2'-0"					PROVIDED BY FB + INSTALLED BY TAG TAG TO PROVIDE + INSTALL BATTERIES
E			SPEAKER					PROVIDED + INSTALLED BY FB
F		TEXAS FLUORESCENTS XT000	UNIVERSAL EXIT LED HED	SURFACE MOUNTED	LED	00071		PROVIDED + INSTALLED BY LL
G		TEXAS FLUORESCENTS R-1	DUAL HEAD EMERGENCY W/ BATTERY PACK	CLG HED (HANG) SEE DETAIL	INCANDESCENT	00071	108	SEE DET. HANG FOR MOUNTING PROVIDED + INSTALLED BY LL
J		TEXAS FLUORESCENTS C2000L20000	8' COMMERCIAL WIDE FLUORESCENT TANDUM STRIPLITE	SURFACE MOUNTED	4 LAMP LED	00071	34	PROVIDED + INSTALLED BY LL
L		TEXAS FLUORESCENTS C2000L20000	FULL CUT-OFF WALL PACKS	SURFACE MOUNTED	3F CREE LED 400	00071	42	PROVIDED + INSTALLED BY LL
N		SPOT SPECIFICS CYLINDR- SPECIESLED5W-160-30K-EX-1200V-66-50- LL-3'-10" HATCH CANOPY COLOR	3" CYLINDER SERIES- UNDER CANOPY LIGHT	SURFACE MOUNTED	1 LAMP	00071	26	PROVIDED + INSTALLED BY LL

1 | LIGHT FIXTURE SCHEDULE

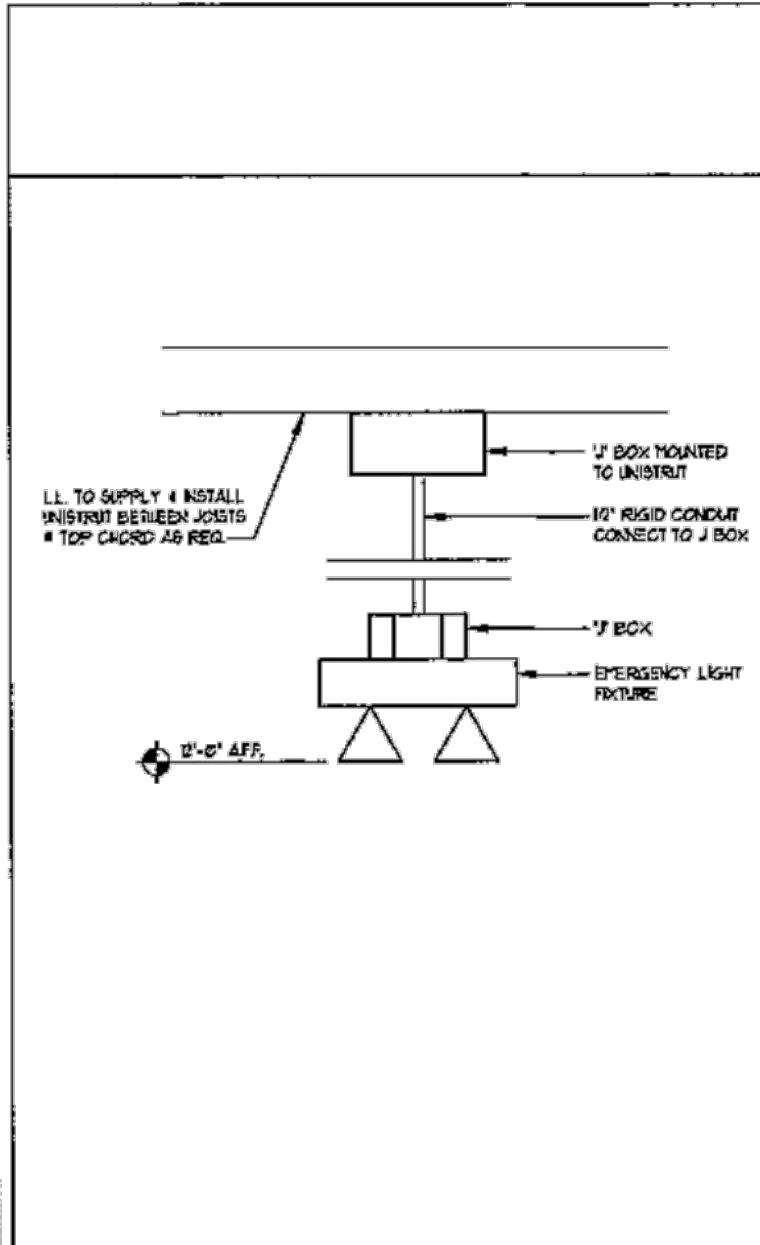

2 | EMERGENCY LIGHT DETL



112 NW 24th Street  
Suite 116  
Fort Worth, TX. 76164  
phone. 682.365.2742  
www.jrkdesign.us

Architect of Record:  
Randy Kelly  
randy.kelly@jrkdesign.us

FIVE BELOW

Revisions

FIVE BELOW  
ALAMO RANCH MARKETPLACE  
5419 W. LOOP 1604 N, Suite 105  
San Antonio, Texas 78253  
05.xx.2016  
TX-16033  
sheet

E-2

