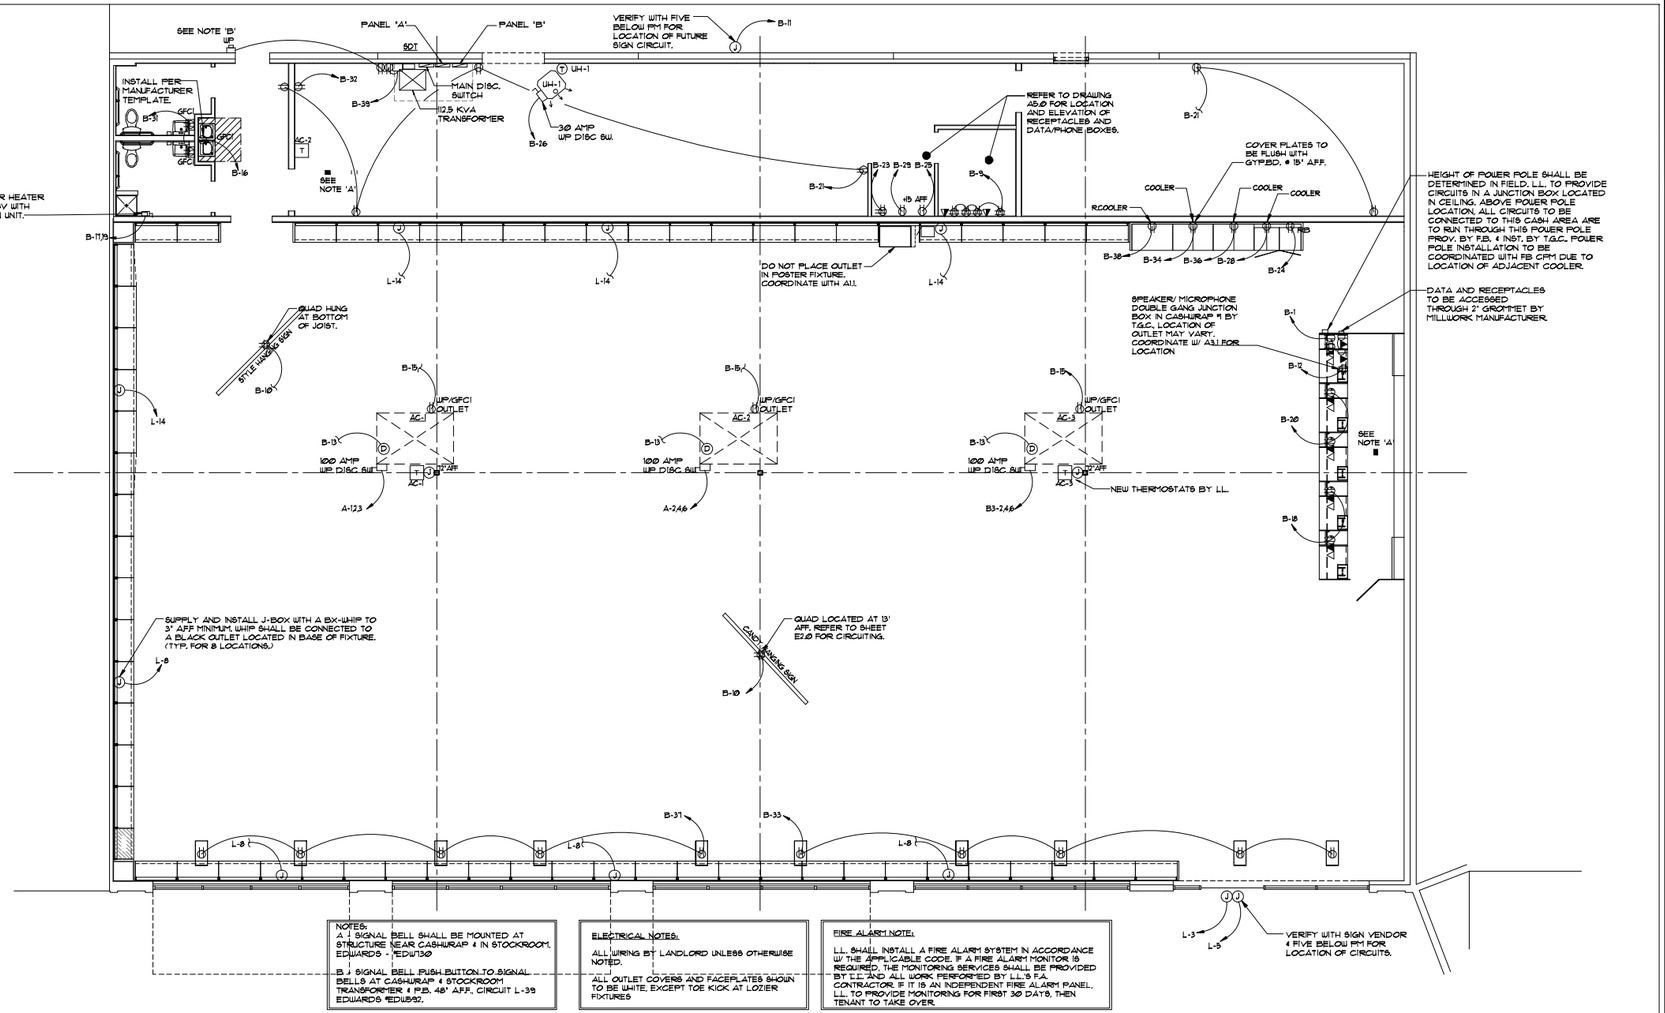

NOTES:
A. 1 SIGNAL BELL SHALL BE MOUNTED AT STRUCTURE NEAR CASHWRAP & IN STOCKROOM. EDWARDS - 1EDW130

B. 1 SIGNAL BELL PUSH BUTTON TO SIGNAL BELLS AT CASHWRAP & STOCKROOM TRANSFORMER @ P.B. 48" A.F.F., CIRCUIT L-38 EDWARDS #EDUB42.

ELECTRICAL NOTES:

ALL WIRING BY LANDLORD UNLESS OTHERWISE NOTED.

ALL OUTLET COVERS AND FACEPLATES SHOWN TO BE WHITE, EXCEPT TOE KICK AT LOZIER FIXTURES

FIRE ALARM NOTE:

LL. SHALL INSTALL A FIRE ALARM SYSTEM IN ACCORDANCE W/ THE APPLICABLE CODE. IF A FIRE ALARM MONITOR IS REQUIRED, THE MONITORING SERVICES SHALL BE PROVIDED BY LL. AND ALL WORK PERFORMED BY L.L.'S F.A. CONTRACTOR. IF IT IS AN INDEPENDENT FIRE ALARM PANEL, LL. TO PROVIDE MONITORING FOR FIRST 30 DAYS, THEN TENANT TO TAKE OVER.

1 ELECTRICAL POWER PLAN

SCALE: 3/16" = 1'-0"

A ELECTRICAL LEGEND

- CONDUIT RUN CONCEALED IN CEILING OR WALLS OR RUN EXPOSED IN NON CEILING AREAS
- RIGID CONDUIT RUN UNDER OR IN FLOOR SLAB
- 12 VOLT DC EMERGENCY WIRING, 2 #10-3/4"C
- A-1 HOME RUN TO PANELBOARD, "A" INDICATES PANEL NO., "1" INDICATES CIR. NO. (2 #12 PLUS EQUIPMENT GROUNDING CONDUCTOR)
- SLASH MARKS INDICATE NO. OF CONDUCTOR IN RACEWAY IF MORE THAN TWO (DOES NOT INCLUDE EQUIPMENT GROUNDING CONDUCTOR)
- DUPLEX RECEPTACLE, 15A-125 VOLT, HUBBELL #5262, 18" AFF UNLESS NOTED
- GFCI DUPLEX OUTLET WITH GROUND FAULT INTERRUPTER, 36" AFF
- DOUBLE DUPLEX RECEPTACLE, 2 @ NEMA 5-15R
- S SINGLE POLE WALL SWITCH, 20A-125 (OR 277) VOLT, HUBBELL #1221-I, 4'-0" AFF
- S3 3 WAY WALL SWITCH, 20A-125 (OR 277) VOLT, HUBBELL #1223-I, 4'-0" AFF
- SHOW WINDOW RECEPTACLE- MOUNTED IN WALL, 12'-6" AFF, TO BOTTOM OF RECEPTACLE
- J JUNCTION BOX
- DISCONNECT SWITCH, NON FUSED UNLESS OTHERWISE NOTED
- PANELBOARD
- TELEPHONE BACKBOARD (9'X AS REQ'D) PROVIDE ONE SEPARATE 3/4" CONDUIT FROM BACKBOARD TO CEILING CAVITY ABOVE
- PUSHBUTTON & TRANSFORMER
- BUZZER & TRANSFORMER
- TC 7-DAY TIME CLOCK - TORK #1900L
- S/R FIRE ALARM SYSTEM IONIZATION TYPE SMOKE DETECTOR AND DUCT DETECTOR HOUSING AND REMOTE INDICATING DEVICE, LOCATED REMOTE INDICATOR IN CEILING BELOW UNIT. PROVIDE AUXILIARY CONTACT AS REQUIRED TO SHUTDOWN AIR HANDLING EQUIPMENT ASSOCIATED WITH DEVICE. REQUIRED IN S/DUCTS OF ALL AIR HANDLING EQUIPMENT ABOVE 2000 CFM AND IN RETURN AIR DUCTS ABOVE 15,000 CFM.
- TELEPHONE OUTLET, PROVIDE CONDUIT AND PULL WIRE TO BACKBOARD
- DATA OUTLET
- TELEPHONE DATA OUTLET
- SDT SMOKE DETECTOR TEST

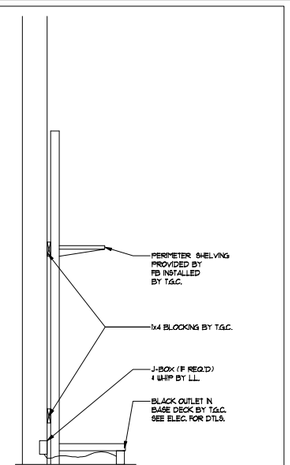

B SEC. @ PERIMETER SHELVING

pdms design group
pdmsdesign.com
2225 E. Randol Mill Road, Suite 300
Arlington, Texas 76011
817.633.4200 p 817.633.4153 f
This drawing and design is proprietary to PDMS Design Group and is furnished in confidence for the limited purpose for which it is loaned. Reproduction or disclosure of this drawing or design in whole or in part by any means is expressly prohibited and may not be distributed or disclosed to others without the prior written consent of PDMS Design Group.

CONSULTANTS

DR
DANIEL A. REEVES, P.E.
2225 E. Randol Mill Rd., Suite 300
Arlington, TX 76011
(817)701-4888
FAX (817)633-4153
Texas Professional Eng. #97463

SEAL

PDMS DESIGN GROUP
F-4255

DATE ISSUE

1	10/13/17	CITY/CUST. COMMENTS
	DATE	REVISION

PROJECT NAME / LOCATION

five BELOW
ARBOR PARK SHOPPING CENTER
17700 SAN PEDRO AVE, SUITE 703
SAN ANTONIO, TX 78232

PROJECT INFORMATION

DATE: 09-07-17
PROJECT NO. 170128
DELIVERY TYPE: V-BOX
DRAWN BY: DAR
CHECKED BY: DAR

SHEET TITLE / NUMBER

POWER PLAN

E1.0